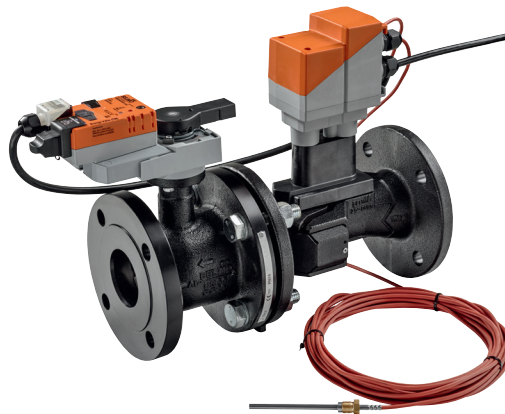


Characterised control valve with sensor-operated flow rate or power control with fail-safe, power and energy-monitoring function, 2-way, Flange, PN 16 (Energy Valve)

- Nominal voltage AC/DC 24 V
- Control modulating, communicative, hybrid, Cloud
- For closed cold and warm water systems
- For modulating control of air-handling and heating systems on the water side
- Ethernet 10/100 Mbit/s, TCP/IP, integrated web server
- Communication via BACnet, Modbus, Belimo MP-Bus or conventional control
- optional Belimo Cloud connection


**Type overview**

Type	DN [ ]	DN ["]	V'nom [ l/s]	V'nom [ l/min]	kvs theor. [ m³/h]	PN [ ]	n(gl) [ ]
<b>EV065F+KBAC</b>	65	2 1/2	8	480	50	16	3.2
<b>EV080F+KBAC</b>	80	3	11	660	75	16	3.2
<b>EV100F+KBAC</b>	100	4	20	1200	127	16	3.2
<b>EV125F+KBAC</b>	125	5	31	1860	195	16	3.2
<b>EV150F+KBAC</b>	150	6	45	2700	254	16	3.2

kvs theory: Theoretical kvs value for pressure drop calculation

**Technical data**

<b>Electrical data</b>	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Nominal voltage range	AC 19.2...28.8 V / DC 21.6...28.8 V
	Power consumption in operation	15.5 W (DN 65...80) 16.5 W (DN 100...150)
	Power consumption in rest position	6.5 W
	Power consumption for wire sizing	26 VA (DN 65...80) 29 VA (DN 100...150)
	Connection supply / control	Cable 1 m, 6 x 0.75 mm²
	Connection control Ethernet	RJ45 socket
	Parallel operation	Yes (note the performance data)
	<b>Functional data</b>	Torque motor
Communicative control		BACnet IP, BACnet MS/TP Modbus TCP, Modbus RTU MP-Bus Cloud
Operating range Y		2...10 V
Input Impedance		100 kΩ
Operating range Y variable		0.5...10 V
Position feedback U		2...10 V
Position feedback U note		Max. 1 mA
Position feedback U variable		0...10 V 0.5...10 V
Setting fail-safe position		NC/NO or adjustable 0...100% (POP rotary knob)
Running time fail-safe		35 s / 90°
Sound power level Motor		45 dB(A)
Sound power level, fail-safe		61 dB(A)
Adjustable flow rate V'max		30...100% of Vnom
Control accuracy	±6% (of 25...100% Vnom) @ 20° C / Glycol 0% vol.	
Control accuracy note	±10% (of 25...100% V'nom)	

## Technical data

<b>Functional data</b>	Parametrisation	via integrated web server / ZTH EU	
	Fluid	Cold and warm water, water with glycol up to max. 50% vol.	
	Fluid temperature	-10...120 °C	
	Permissible operating pressure ps	1600 kPa	
	Close-off pressure $\Delta p_s$	690 kPa	
	Differential pressure $\Delta p_{max}$	340 kPa	
	Flow characteristic	equal percentage (VDI/VDE 2178), optimised in the opening range (switchable to linear)	
	Leakage rate	air-bubble tight, leakage rate A (EN 12266-1)	
	Pipe connectors	Flange PN 16 according to EN 1092-2	
	Installation position	upright to horizontal (in relation to the stem)	
	Servicing	maintenance-free	
	Manual override	with push-button	
	<b>Flow measurement</b>	Measuring principle	Ultrasonic volumetric flow measurement
		Measuring accuracy flow	$\pm 2\%$ (of 25...100% V <sub>nom</sub> ) @ 20 °C / Glycol 0% vol.
Measuring accuracy flow note		$\pm 6\%$ (of 25...100% V <sub>nom</sub> )	
Min. flow measurement		1% of V <sub>nom</sub>	
<b>Temperature measurement</b>	Measuring accuracy absolute temperature	$\pm 0.6$ °C @ 60 °C (Pt1000 EN60751 Class B)	
	Measuring accuracy temperature difference	$\pm 0.23$ K @ $\Delta T = 20$ K	
	Resolution	0.05 °C	
<b>Safety</b>	Protection class IEC/EN	III Protective extra-low voltage (PELV)	
	Degree of protection IEC/EN	IP54	
	Degree of protection note	IP protection when using protective cap or protective grommet for RJ45 socket	
	EMC	CE according to 2014/30/EU	
	Mode of operation	Type 1.AA	
	Rated impulse voltage supply / control	0.8 kV	
	Control pollution degree	3	
	Ambient temperature	-30...50 °C	
	Storage temperature	-40...80 °C	
	Ambient humidity	Max. 95% r.H., non-condensing	
<b>Materials</b>	Flow measuring pipe	EN-GJL-250 (GG 25), with protective paint	
	Closing element	stainless steel AISI 316	
	Stem seal	EPDM	
	Ball seat	PTFE, O-ring Viton	
	Immersion sleeve	Stainless steel AISI 316Ti	
<b>Terms</b>	Abbreviations	POP = Power off position / fail-safe position	

## Safety notes




- This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application, especially in aircraft or in any other airborne means of transport.
- Outdoor application: only possible in case that no (sea) water, snow, ice, insolation or aggressive gases interfere directly with the actuator and that is ensured that the ambient conditions remain at any time within the thresholds according to the data sheet.
- Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.
- The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

Product features


**Mode of operation** The HVAC performance device is comprised of four components: characterised control valve (CCV), measuring pipe with volumetric flow sensor, temperature sensors and the actuator itself. The adjusted maximum flow ( $V'_{max}$ ) is assigned to the maximum positioning signal (typically 10 V / 100%). Alternatively, the positioning signal can be assigned to the valve opening angle or to the power required on the heat exchanger (see power control). The HVAC performance device can be controlled communicative or analogue. The fluid is detected by the sensor in the measuring pipe and is applied as the flow value. The measured value is balanced with the setpoint. The actuator corrects the deviation by changing the valve position. The angle of rotation  $\alpha$  varies according to the differential pressure through the final controlling element (see flow rate curves).  
 With the supply voltage the integrated condensers will be charged. Interrupting the supply voltage causes the valve to be moved to the selected fail-safe position by means of stored electrical energy.

Flow characteristic

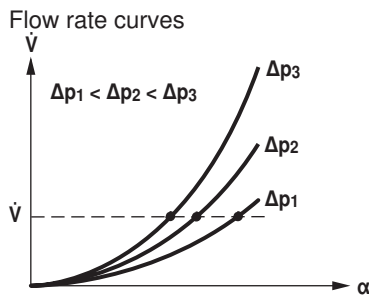

**Pre-charging time (start up)** The capacitor actuators require a pre-charging time. This time is used for charging the capacitors up to a usable voltage level. This ensures that, in the event of a power failure, the actuator can move at any time from its current position into the preset fail-safe position. The duration of the pre-charging time depends mainly on how long the power was interrupted.

Typical pre-charging time

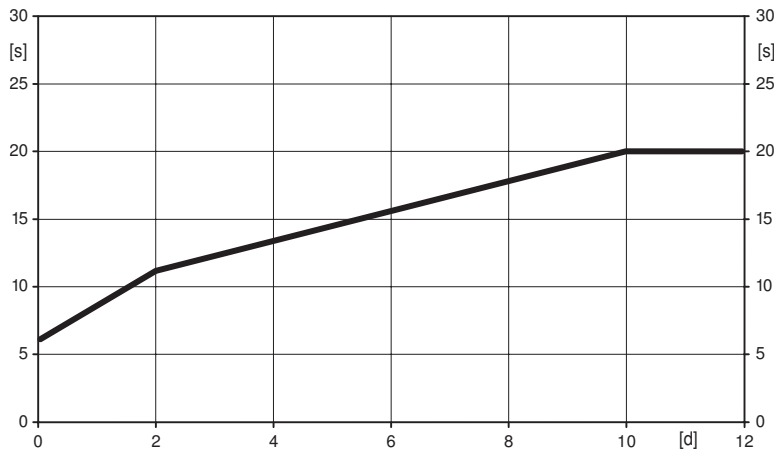

	[d]				
	0	1	2	7	≥10
[s]	6	9	11	16	20


[d] = Electricity interruption in days  
 [s] = Pre-charging time in seconds

**Delivery condition (capacitors)** The actuator is completely discharged after delivery from the factory, which is why the actuator requires approximately 20 s pre-charging time before initial commissioning in order to bring the capacitors up to the required voltage level.

**Setting fail-safe position (POP)** The rotary knob fail-safe position can be used to adjust the desired fail-safe position 0...100% in 10% increments. The rotary knob always refers to the adapted angle of rotation range. In the event of a power failure, the actuator will move into the selected fail-safe position.

**Product features**

**Transmission behaviour HE** Heat exchanger transmission behaviour  
 Depending on the construction, temperature spread, fluid characteristics and hydraulic circuit, the power  $Q$  is not proportional to the water volumetric flow  $\dot{V}$  (Curve 1). With the classical type of temperature control, an attempt is made to maintain the control signal  $Y$  proportional to the power  $Q$  (Curve 2). This is achieved by means of an equal-percentage valve characteristic curve (Curve 3).

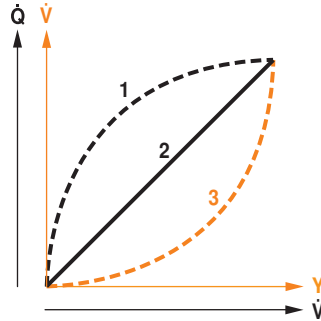

**Power control** Alternatively, the positioning signal  $Y$  can be assigned to the output power required on the heat exchanger.  
 Depending on the water temperature and air conditions, the Energy Valve ensures the amount of water required to achieve the desired power.

Maximum controllable power on heat exchanger in power control mode:


<b>DN 65</b>	1700 kW
<b>DN 80</b>	2400 kW
<b>DN 100</b>	4200 kW
<b>DN 125</b>	6500 kW
<b>DN 150</b>	9500 kW

**Control characteristics** The specially configured control parameters in connection with the precise velocity sensor ensure a stable quality of control. They are, however, not suitable for rapid control processes, i.e. for domestic water control.

**Definition** Flow control  
 $V'_{nom}$  is the maximum possible flow.

$V'_{max}$  is the maximum flow rate which has been set with the greatest positioning signal.  $V'_{max}$  can be set between 30% and 100% of  $V'_{nom}$ .

$V'_{min}$  0% (non-variable).

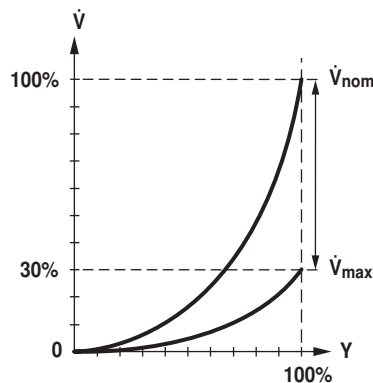


## Product features

**Definition** Power control  
 $Q'_{nom}$  is the maximum possible power output on the heat exchanger.

$Q'_{max}$  is the maximum power output on the heat exchanger which has been set with the greatest positioning signal.  $Q'_{max}$  can be set between 1% and 100% of  $Q'_{nom}$ .

$Q'_{min}$  0% (non-variable).

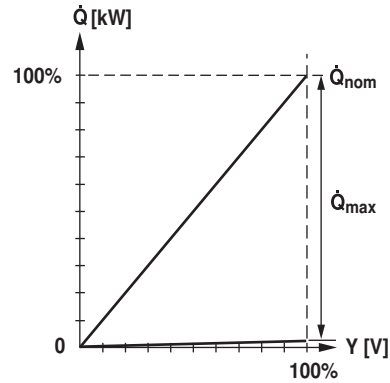


**Creep flow suppression** Given the very low flow speed in the opening point, this can no longer be measured by the sensor within the required tolerance. This range is overridden electronically.

### Opening valve

The valve remains closed until the volumetric flow required by the positioning signal  $Y$  corresponds to 1% of  $V'_{nom}$ . The control along the valve characteristic curve is active after this value has been exceeded.

### Closing valve

The control along the valve characteristic curve is active up to the required flow rate of 1% of  $V'_{nom}$ . Once the level falls below this value, the flow rate is maintained at 1% of  $V'_{nom}$ . If the level falls below the flow rate of 0.5% of  $V'_{nom}$  required by the reference variable  $Y$ , then the valve will close.

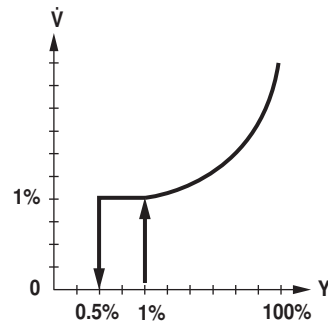

## Product features

**Communication** The parametrisation can be carried out through the integrated web server (RJ45 connection to the web browser) or by communicative means. Additional information regarding the integrated web server can be found in the separate documentation.

**“Peer to Peer” connection**

<http://belimo.local:8080>

The Notebook must be set to “DHCP”.

Make sure that only one network connection is active.

**Standard IP address:**


<http://192.168.0.10:8080>

Static IP address

**Password (read-only):**

User name: «guest»

Password: «guest»

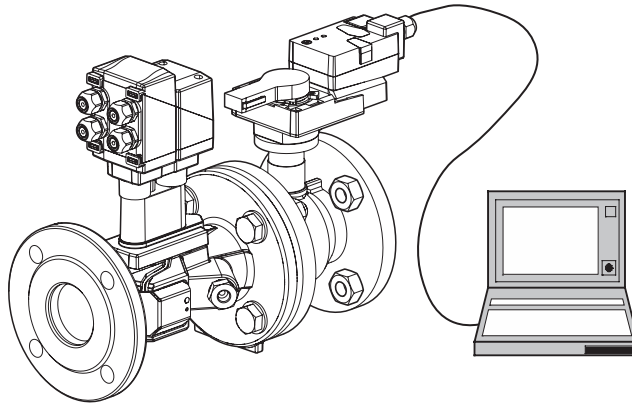

**Positioning signal inversion**

This can be inverted in cases of control with an analogue positioning signal. The inversion causes the reversal of the standard behaviour, i.e. at a positioning signal of 0%, regulation is to V'max or Q'max, and the valve is closed at a positioning signal of 100%.

**Hydraulic balancing**

Via the integrated web server, the maximum flow rate (equivalent to 100% requirement) can be adjusted on the device itself, simply and reliably, in a few steps. If the device is integrated in the management system, then the balancing can be handled directly by the management system.


**Delta-T manager**

If a heating or cooling register is operated with a differential temperature that is too low and thus with a flow rate that is too high, this will not result in an increased power output.

Nevertheless, heating or cooling machines must provide the energy at a lower degree of efficiency. This means, that pumps circulate too much water and increase energy consumption unnecessarily.

With the aid of the Energy Valve, it is simple to discover that operation is being carried out at a differential temperature that is too low, resulting in the inefficient use of energy. Necessary setting adjustments can now be carried out quickly and easily at any time. The integrated differential temperature limiting offers the user the possibility of defining a low limit value. The Energy Valve limits the flow rate automatically to prevent the level from falling below this value.

The settings of the Delta-T manager can be made either directly on the web server or via the Belimo Cloud a direct analysis of the Delta-T behavior is carried out by Belimo experts.

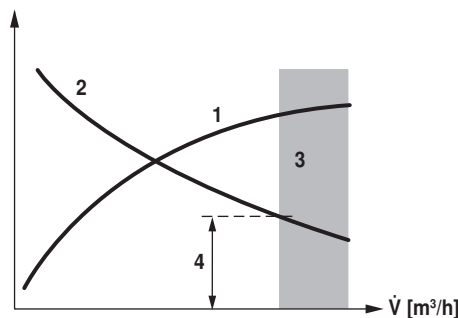

Power output of the heating or cooling registers 1

Diff. temperature between supply and return 2

Loss zone (heating or cooling register saturation) 3

Adjustable minimum differential temperature 4

**Combination analogue - communicative (hybrid mode)**

With conventional control by means of an analogue positioning signal, the integrated web server, BACnet, Modbus or MP-Bus can be used for the communicative position feedback.

## Product features

<b>Power and energy monitoring function</b>	The final controlling device is equipped with two temperature sensors. One sensor (T2) is integrated in the measuring pipe, the second sensor (T1) is included with the system, prewired, and must be installed in the water circulation on site. The sensors are used to record the fluid temperature of the supply and return lines of the consumer (heat/cold register). As the water quantity is also known, thanks to the volumetric flow measurement integrated in the system, the power released from the consumer can be calculated. Furthermore, the heating/cooling energy is also determined automatically by means of the evaluation of the power over time. The current data, e.g. temperatures, volumetric flow volumes, exchanger energy consumption etc. can be recorded and accessed at any time by means of web browsers or communication.
<b>Data recording</b>	The recorded data (integrated data recording for 13 months) can be used for the optimisation of the overall system and for the determination of the performance of the consumer. Download csv files through web browser.
<b>Belimo Cloud</b>	Additional Services are available, if the Energy Valve is connected to the Belimo Cloud: for instance, several devices may be managed via Internet. Also Belimo experts may help analyse the delta-T behavior or provide written reports about the Energy Valve performance. Under certain conditions, the product warranty according to the applicable Terms and Conditions of Sale may be prolonged. Further details may be found under [ <a href="http://www.belimo.com/ext-warranty">www.belimo.com/ext-warranty</a> ]
<b>Manual override</b>	Manual control with push-button possible - temporary. The gear is disengaged and the actuator decoupled for as long as the button is pressed.
<b>High functional reliability</b>	The actuator is overload protected, requires no limit switches and automatically stops when the end stop is reached.

## Accessories

	Description	Type
<b>Electrical accessories</b>	Grommet for RJ connection module Multipack 50 pcs.	Z-STRJ.1
	Stem heating flange F05 DN25...100 (30 W)	ZR24-F05
	Connection cable 5 m, A: RJ11 6/4 ZTH EU, B: 6-pin service socket for Belimo device	ZK1-GEN
	Description	Type
<b>Service Tools</b>	Service Tool, Setting tool with ZIP-USB function	ZTH EU

## Electrical installation




### Notes

- Connection via safety isolating transformer.
- Parallel connection of other actuators possible. Observe the performance data.
- The wiring of the line for BACnet MS/TP / Modbus RTU is to be carried out in accordance with applicable RS485 regulations.
- Modbus / BACnet: Supply and communication are not galvanically isolated. Connect earth signal of the devices with one another.

**Electrical installation**


**Wiring diagrams**

Conventional operation

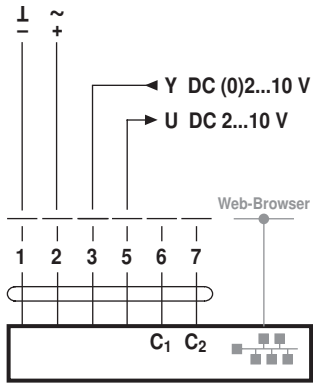

**Cable colours:**


- 1 = black
- 2 = red
- 3 = white
- 5 = orange
- 6 = pink
- 7 = grey



Connection of a notebook for parameterisation and manual control via RJ45.


Optional connection via RJ45 (direct connection Notebook / connection via Intranet or Internet) for access to the integrated web server

MP-Bus, supply via 3-wire connection

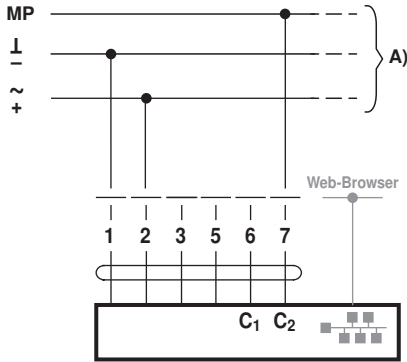


A) Additional actuators and sensors (max. 8)

MP-Bus via 2-wire connection, local power supply

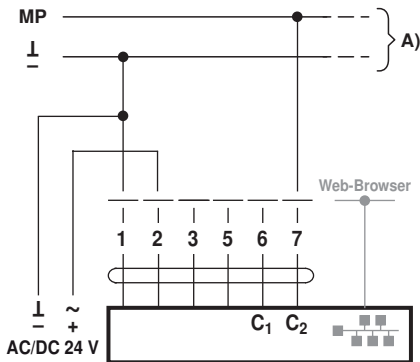

A) Additional actuators and sensors (max. 8)

MP-Bus Network topology

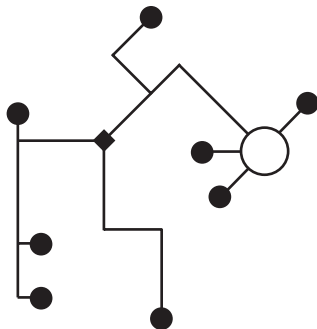

There are no restrictions for the network topology (star, ring, tree or mixed forms are permitted). Supply and communication in one and the same 3-wire cable


- no shielding or twisting necessary
- no terminating resistors required




**Functions**

**Functions for devices with specific parameters (Parametrisation necessary)**


BACnet MS/TP / Modbus RTU

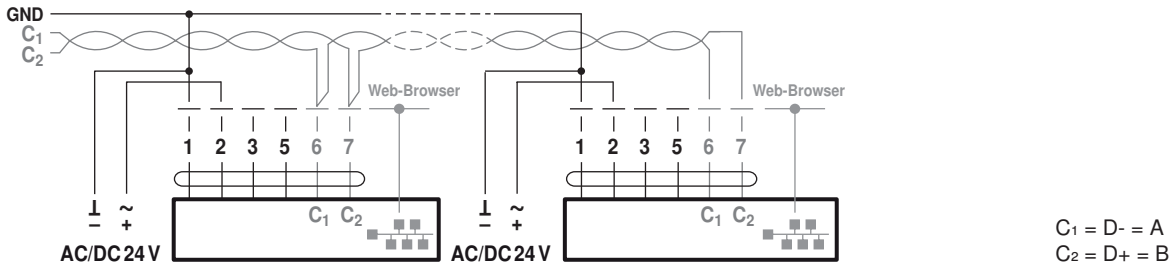



BACnet IP / Modbus TCP

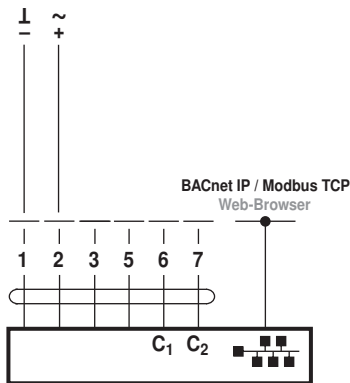


MP-Bus with analog setpoint (hybrid mode)

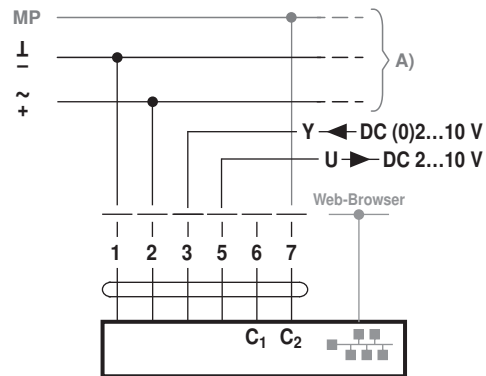

BACnet MS/TP / Modbus RTU with analog setpoint (hybrid mode) BACnet IP / Modbus TCP with analog setpoint (hybrid mode)

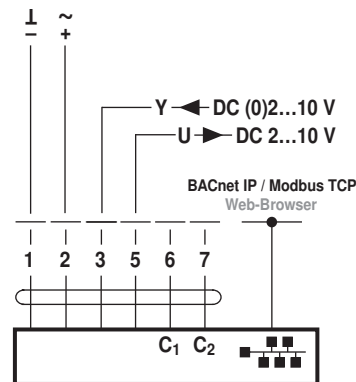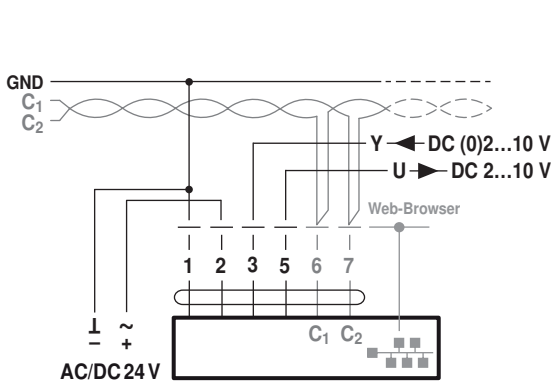


Override control and limiting with DC 24 V with relay contacts (with conventional control or hybrid mode)

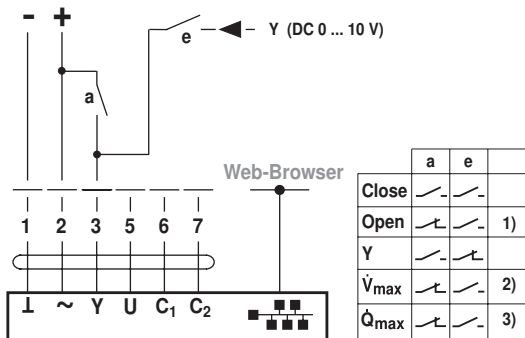




- 1) Position control
- 2) Flow control
- 3) Power control

Operating controls and indicators

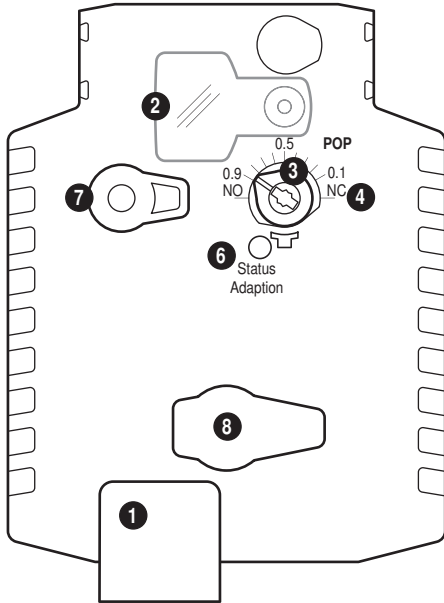


- 1 LED display green**  
 Off: No power supply or wiring errors  
 On: In operation  
 Flickering: Internal communication (Valve/Sensor)
- 2 Cover, POP button**
- 3 POP button**
- 4 Scale for manual adjustment**
- 6 Push-button and LED display yellow**  
 On: Adaptation process active  
 Flashing: POP function active  
 Off: Not in operation, pre-charging time SuperCap, fault SuperCap  
 Press button: Triggers angle of rotation adaptation, followed by standard mode
- 7 Gear disengagement button**  
 Press button: Gear disengages, motor stops, manual override possible  
 Release button: Gear engages, followed by standard mode
- 8 Service plug**  
 For connecting the ZTH EU

Setting emergency setting position (POP)

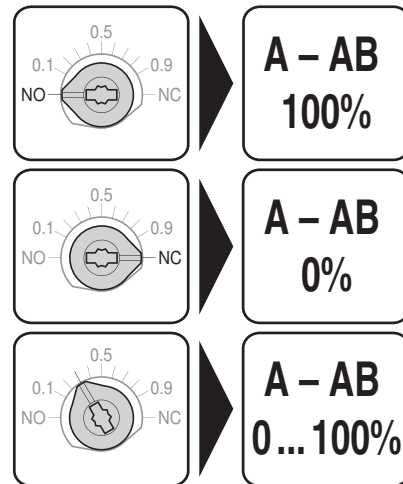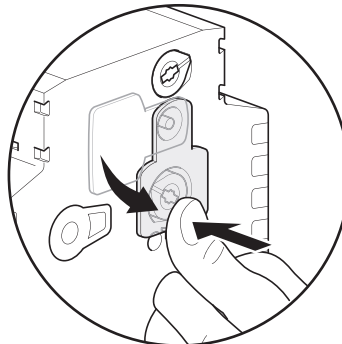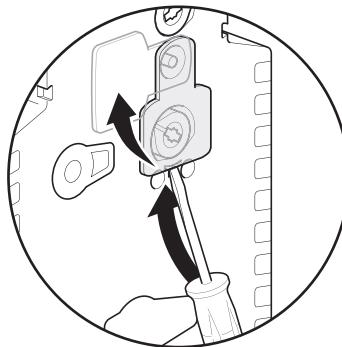

## Installation notes

**Recommended installation positions** The ball valve can be installed upright to horizontal. The ball valve may not be installed in a hanging position, i.e. with the stem pointing downwards.



**Mounting position in the return** Installation in the return is recommended.

**Water quality requirements** The water quality requirements specified in VDI 2035 must be adhered to. Belimo valves are regulating devices. For the valves to function correctly in the long term, they must be kept free from particle debris (e.g. welding beads during installation work). The installation of a suitable strainer is recommended. The water must exhibit a conductivity  $\geq 20 \mu\text{S}/\text{cm}$  during operation for correct functioning. It should be noted that, under normal circumstances, even filling water with a lower conductivity will experience an elevation of its conductivity to above the minimum required value during filling and that the system can thus be put into operation.

Elevation of conductivity during filling caused by:


- untreated residual water from pressure test or pre-rinsing
- metal salts (e.g. surface rust) dissolved out of the raw material

**Stem heating** In cold water applications and warm humid ambient air can cause condensation in the actuators. This can lead to corrosion in the gear box of the actuator and causes a breakdown of it. In such applications, the use of a stem heating is provided. The stem heating must be enabled only when the system is in operation, because it does not have temperature control.

**Servicing** Ball valves, rotary actuators and sensors are maintenance-free. Before any service work on the final controlling device is carried out, it is essential to isolate the rotary actuator from the power supply (by unplugging the electrical cable if necessary). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow all components to cool down first if necessary and always reduce the system pressure to ambient pressure level). The system must not be returned to service until the ball valve and the rotary actuator have been correctly reassembled in accordance with the instructions and the pipeline has been refilled by professionally trained personnel.

**Flow direction** The direction of flow, specified by an arrow on the housing, is to be complied with, since otherwise the flow rate will be measured incorrectly.

**Inlet section** In order to achieve the specified measuring accuracy, a flow-calming section or inflow section in the direction of the flow is to be provided upstream from the flow sensor. Its dimensions should be at least  $5 \times \text{DN}$ .

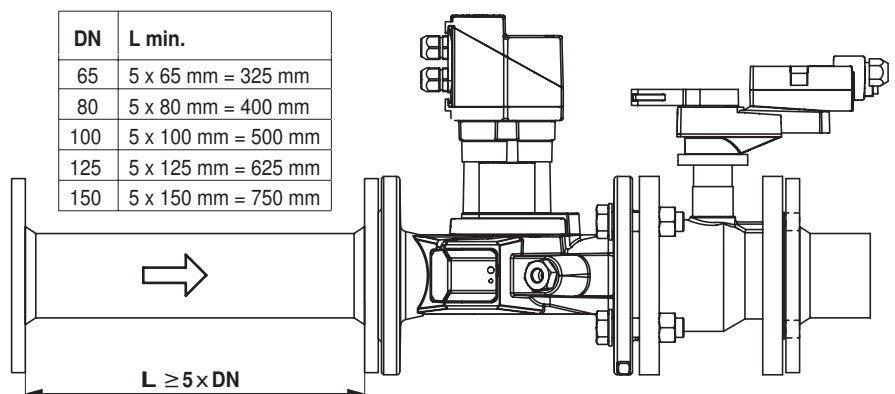

## Installation notes

### Installation of immersion sleeve and temperature sensor


The valve is equipped with two temperature sensors:

- T2: One sensor is already installed in the valve unit.
- T1: The second sensor must be mounted at the installation site ahead of the consumer (valve in the return line; recommended) or after the consumer (valve in the supply line). The immersion sleeve required is supplied with the valve unit.

The temperature sensor is already wired with the valve.

#### Note

The cable between valve unit and temperature sensor may not be either shortened or lengthened.

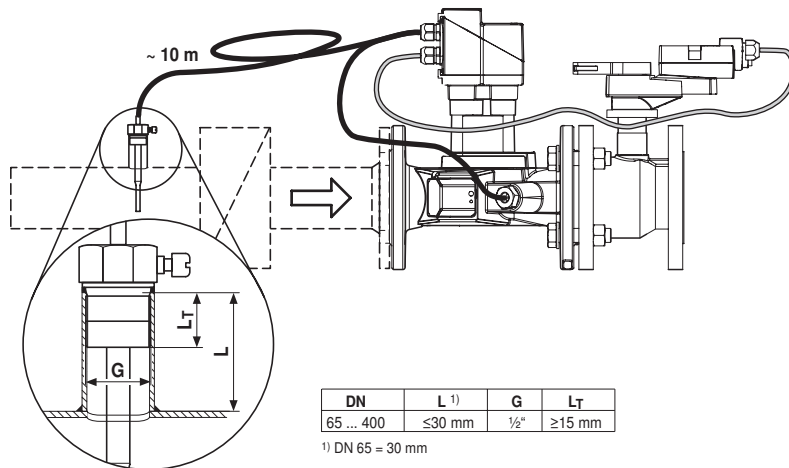

## General notes

**Valve selection** The valve is determined using the maximum required flow rate  $\dot{V}'_{max}$ .

A calculation of the kvs value is not required.

$\dot{V}'_{max} = 30 \dots 100\%$  of  $\dot{V}'_{nom}$

If no hydraulic data are available, then the same valve DN can be selected as the heat exchanger nominal diameter.

### Minimum differential pressure (pressure drop)

The minimum required differential pressure (pressure drop through the valve) for achieving the desired volumetric flow  $\dot{V}'_{max}$  can be calculated with the aid of the theoretical kvs value (see type overview) and the below-mentioned formula. The calculated value is dependent on the required maximum volumetric flow  $\dot{V}'_{max}$ . Higher differential pressures are compensated for automatically by the valve.

Formula

$$\Delta p_{min} = 100 \times \left( \frac{\dot{V}'_{max}}{k_{vs \text{ theor.}}} \right)^2$$

$\Delta p_{min}$ : kPa
$\dot{V}'_{max}$ : m <sup>3</sup> /h
$k_{vs \text{ theor.}}$ : m <sup>3</sup> /h

Example (DN100 with the desired maximum flow rate = 50%  $\dot{V}'_{nom}$ )

EV100F+KBAC

$k_{vs \text{ theor.}} = 127 \text{ m}^3/\text{h}$

$\dot{V}'_{nom} = 1200 \text{ l}/\text{min}$

$50\% \times 1200 \text{ l}/\text{min} = 600 \text{ l}/\text{min} = 36 \text{ m}^3/\text{h}$

$$\Delta p_{min} = 100 \times \left( \frac{\dot{V}'_{max}}{k_{vs \text{ theor.}}} \right)^2 = 100 \times \left( \frac{36 \text{ m}^3/\text{h}}{127 \text{ m}^3/\text{h}} \right)^2 = 8 \text{ kPa}$$


### Valve selection

In case of a flow sensor error, the Energy Valve will switch from either power or flow control to position control (Delta-T manager will be deactivated).

Once the error disappears, the Energy Valve will switch back to the normal control setting (Delta-T manager activated)

## Dimensions / Weight

## Dimensional drawings

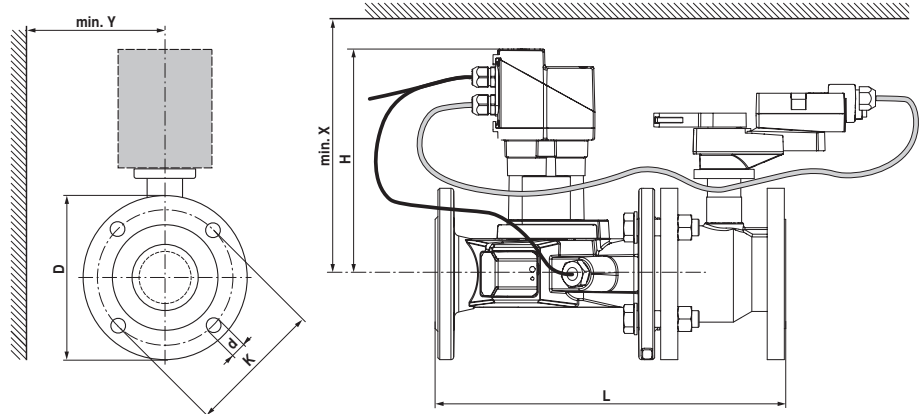

If Y < 180 mm, the extension of the hand crank must be demounted as necessary.

Type	DN [ ]	L [ mm]	H [ mm]	D [ mm]	d [ mm]	K [ mm]	X [ mm]	Y [ mm]	Weight
EV065F+KBAC	65	379	243	185	4 x 19	145	265	150	26 kg
EV080F+KBAC	80	430	250	200	8 x 19	160	270	160	35 kg
EV100F+KBAC	100	474	252	230	8 x 19	180	275	175	52 kg
EV125F+KBAC	125	579	259	255	8 x 19	210	280	190	70 kg
EV150F+KBAC	150	651	269	285	8 x 23	240	290	200	90 kg

## Further documentation

- Tool connections
- Description Protocol Implementation Conformance Statement PICS
- Description Modbus register
- Description Data-Pool Values
- Overview MP Cooperation Partners
- MP Glossary
- Introduction to MP-Bus Technology
- General notes for project planning
- Instruction Webserver