


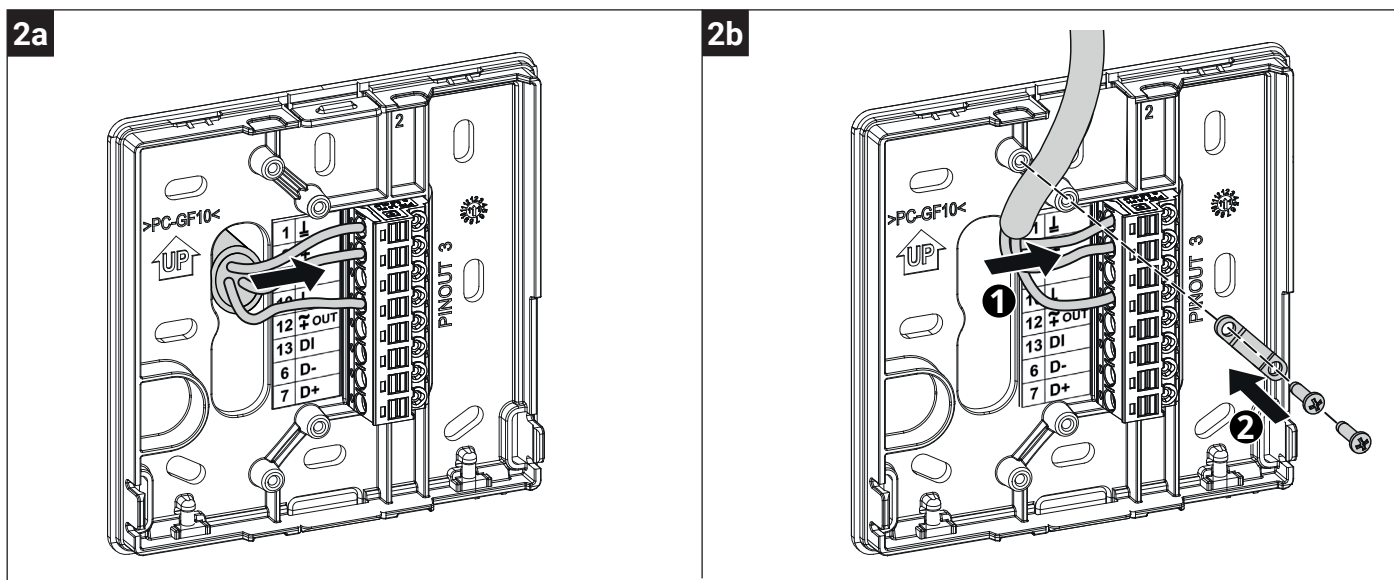
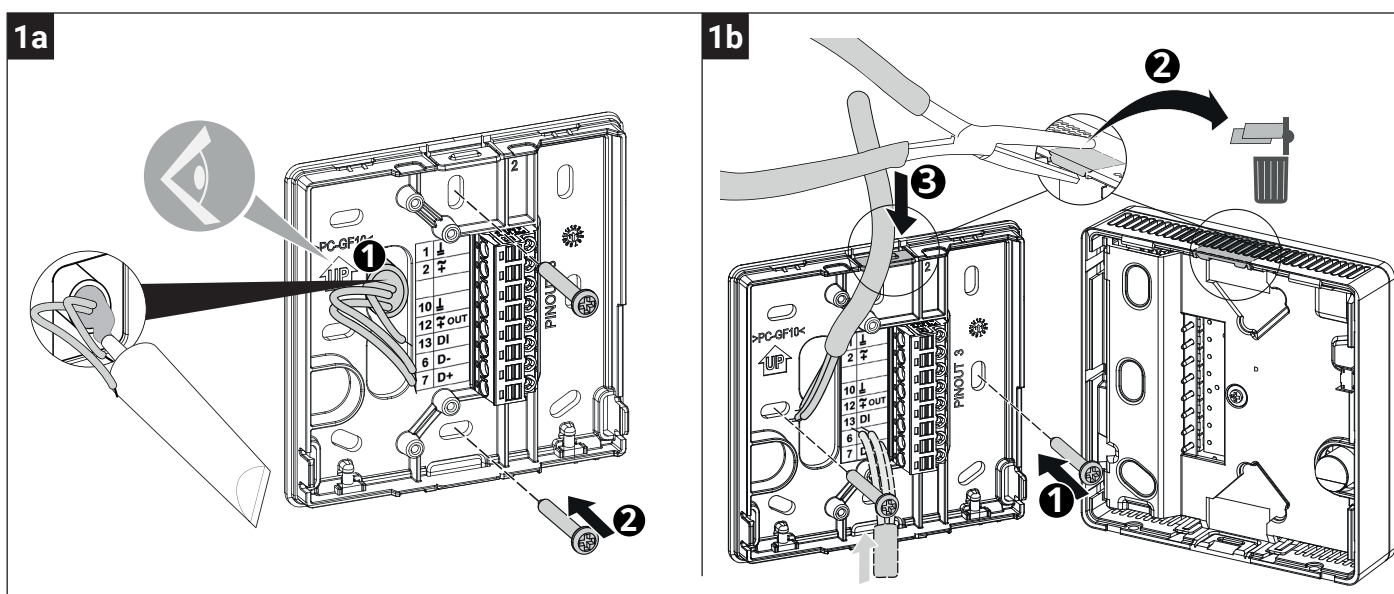


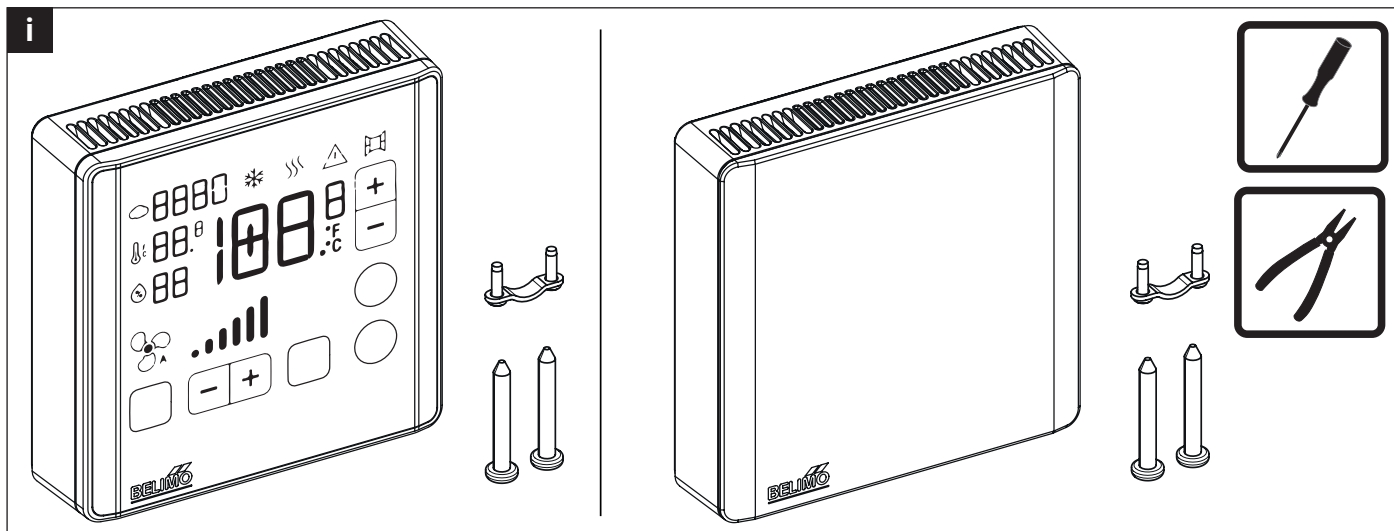


3

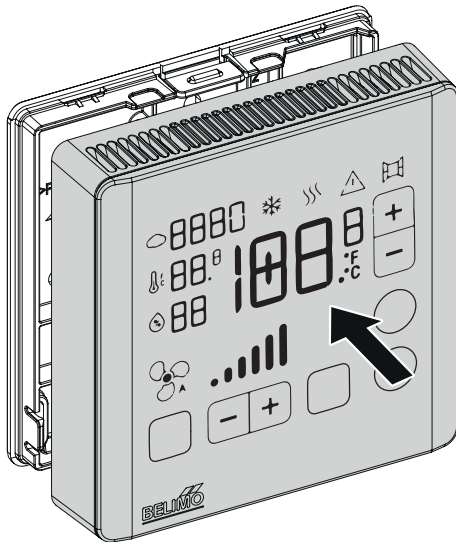



4

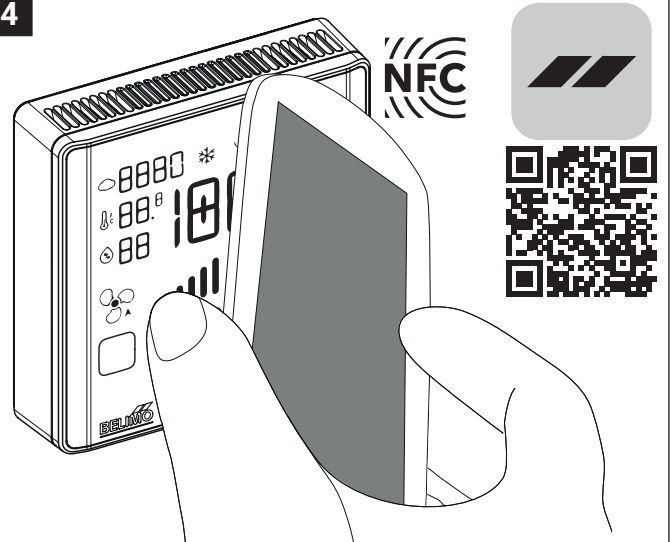

BACnet MS/TP, Modbus RTU

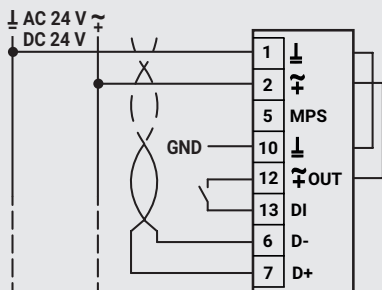

MP-Bus

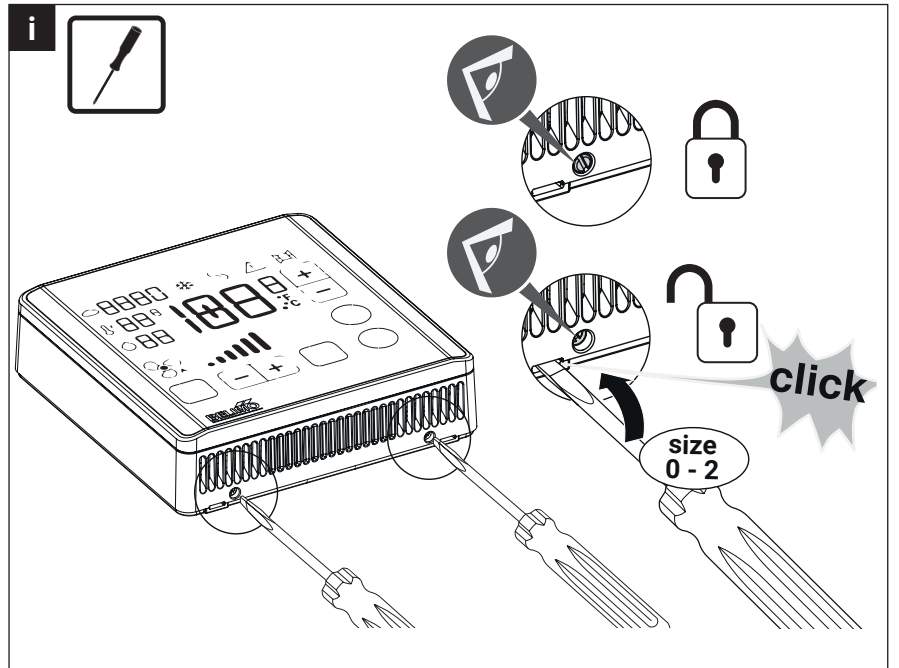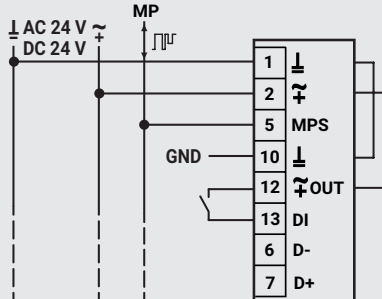

i

